



## PARKWAY AREAS

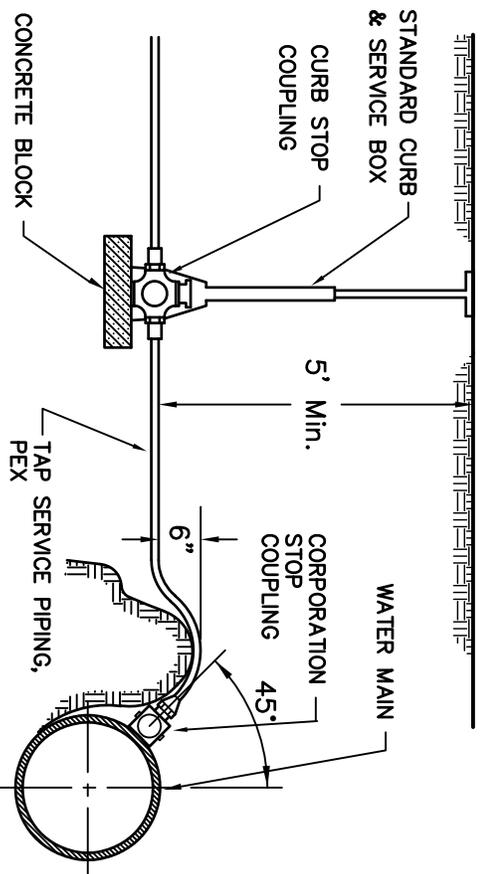

## PAVED AREAS

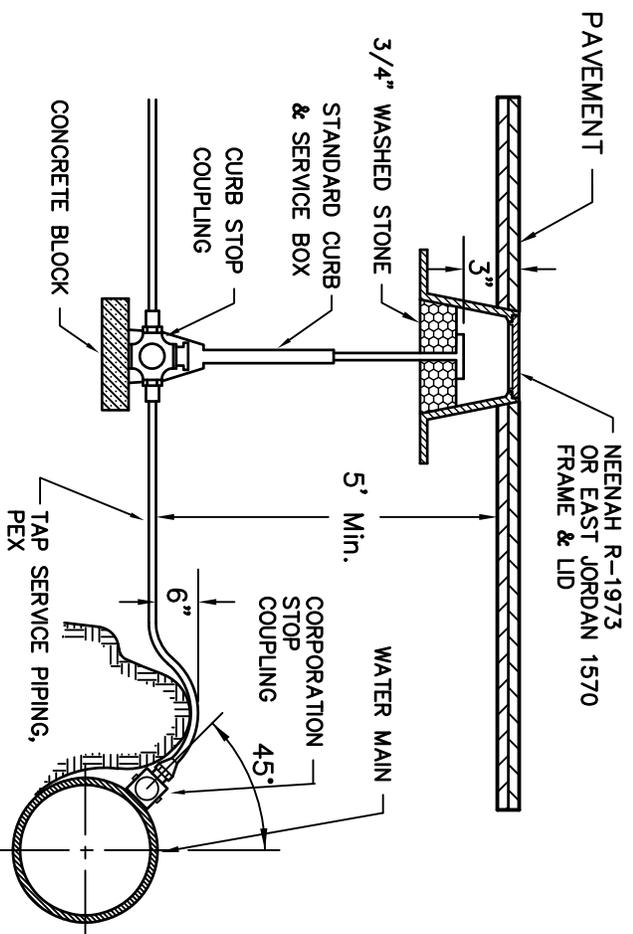

- NOTES:**
1. WATER SERVICES UP TO 2" DIAMETER SHALL BE PEX (GROSS LINKED POLYETHYLENE) CONFORMING TO THE LATEST REVISED SPECIFICATION REQUIREMENT OF ASTM F876. WATER SERVICES LARGER THAN 2" DIAMETER SHALL BE A MINIMUM 4" DIAMETER DUCTILE IRON PIPE. MINIMUM SIZE FOR RESIDENTIAL UNITS SHALL BE 1" IN DIAMETER.

2. CORPORATION STOPS SHALL BE MCDONALD NO. 74701Q, MUELLER H-15008N, OR FORD F-1000.
3. CURB STOPS SHALL BE MCDONALD NO. 76104Q, MUELLER B-25029N OR FORD B44 WITH MINNEAPOLIS PATTERN B-BOXES SIMILAR TO MCDONALD NO. 5614 OR MUELLER H-10300.

UNITED CITY OF YORKVILLE

### TYPICAL SERVICE TAP AND CONNECTION

|                  |                          |   |                   |
|------------------|--------------------------|---|-------------------|
|                  |                          | <b>Engineering Enterprises, Inc.</b><br>52 Wheeler Road<br>Sugar Grove, Illinois 60554<br>Phone: (630) 486-9350 |                   |
|                  |                          | SCALE:<br>N.T.S.  | DATE:<br>02/21/20 |
| FOLDER:<br>YO-WA | DRAWING NUMBER:<br>WS-02 | DRAWN BY:<br>JPS  | REVISED:          |